


# standard adjustable bed remote control


Remote Control arrives paired to the adjustable base.  
Three (3) AAA batteries are required to operate the remote.



## ADJUST

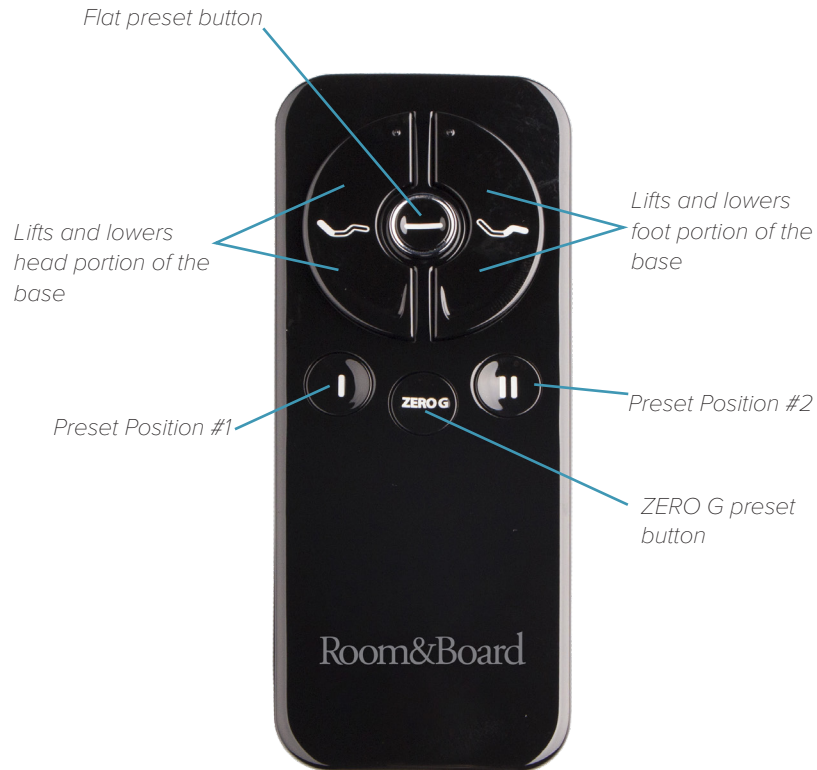

The HEAD ▲ ▼ arrows lift and lower the head section of the base.



The FOOT ▲ ▼ arrows lift and lower the foot section of the base.



One touch FLAT preset position.



One touch ZERO-G preset position. Zero-G adjusts your legs to a higher level than your heart helping to relieve pressure off the lower back and promote circulation.



Preset Position #1.



Preset Position #2.

